


Line Post Insulators

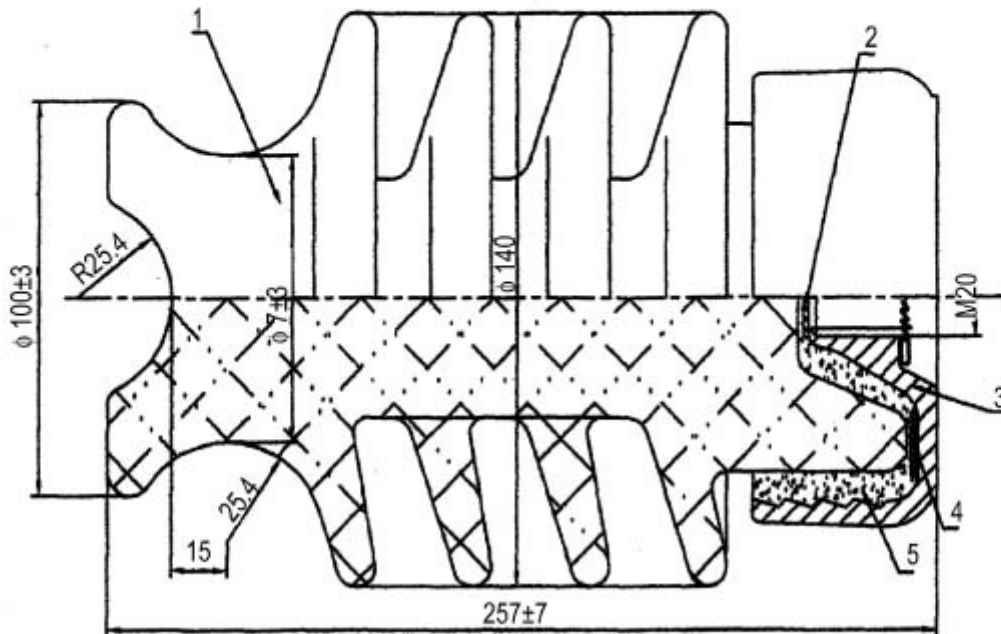

P2127G

Technical Specification

1. Creepage Distance : more than 381 mm
2. Arcing distance not less than 197 mm
3. PF Flashover Voltage : dry - 95 kV (rms)
Wet : 65 kV (rms)
4. Lightning impulse flashover voltage : Pos - 135 kV(peak)
Neg : 190 kV (peak)
5. Cantilever failing load : 12.5 kN, Cantilever test load : 6.7 kN
6. Radio Influence voltage data : test voltage to ground, 20kV
Max. RIV at 1000 kHz 50 uV
7. Comply with ANSI C29.7 except the drawing.



POWERLINE HARDWARE

245 North Lane Avenue
Jacksonville, Florida 32254
Phone: 904-695-9880
Fax: 904-695-9717

Website: www.powerlinehardware.com